







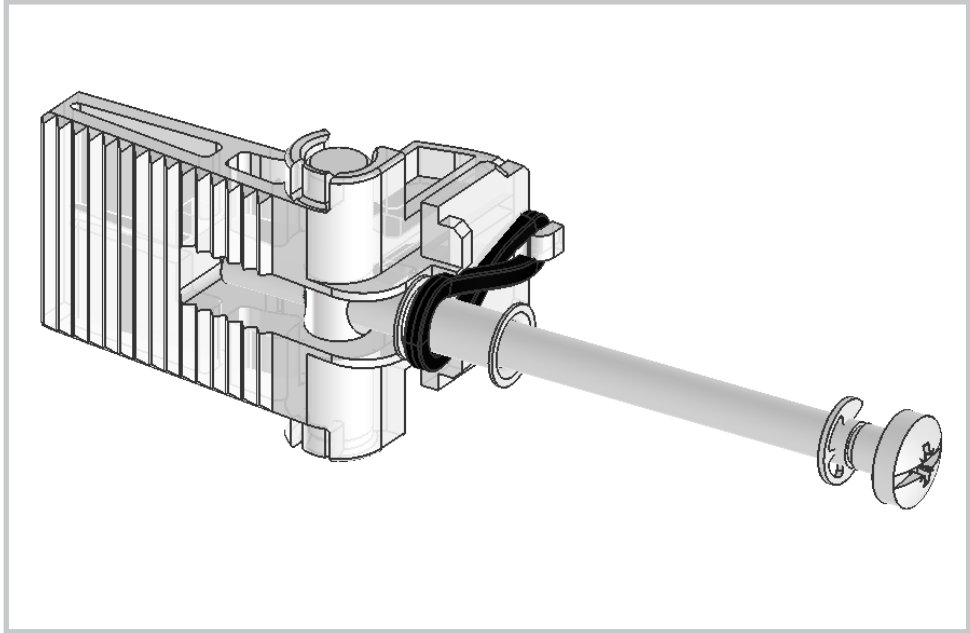

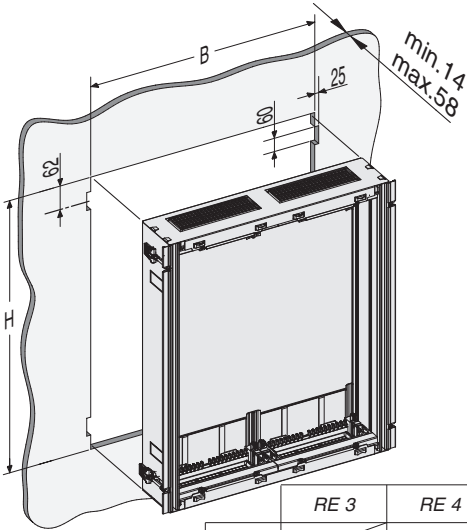


min.14
max.58



	RE 3	RE 4	RE 5	RE 6	RE 7
FB 1		684 x 310	834 x 310	984 x 310	
FB 2	534 x 560	684 x 560	834 x 560	984 x 560	1134 x 560
FB 3		684 x 810	834 x 810	984 x 810	1134 x 810
FB 4			834 x 1060	984 x 1060	

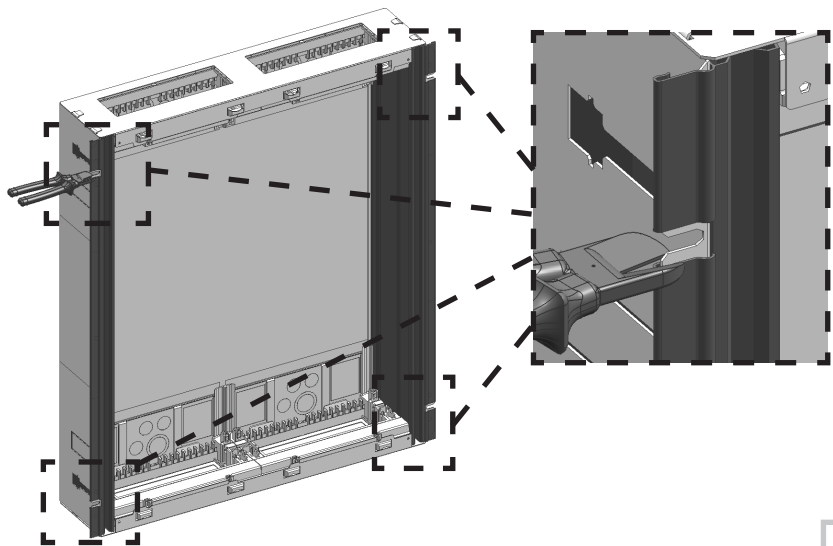

1

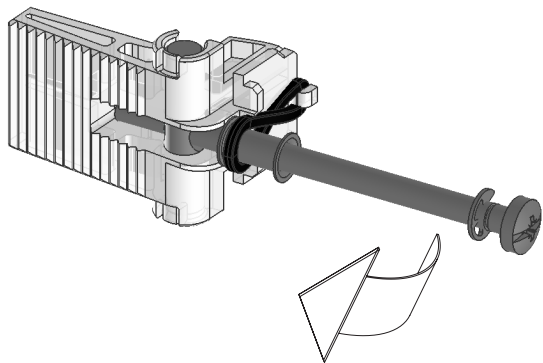

2

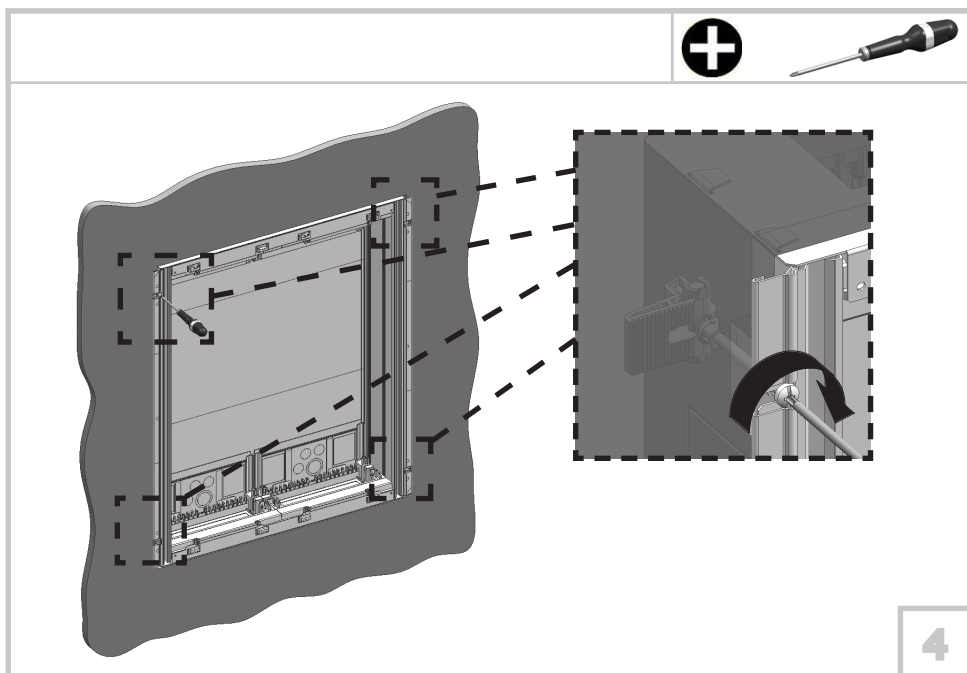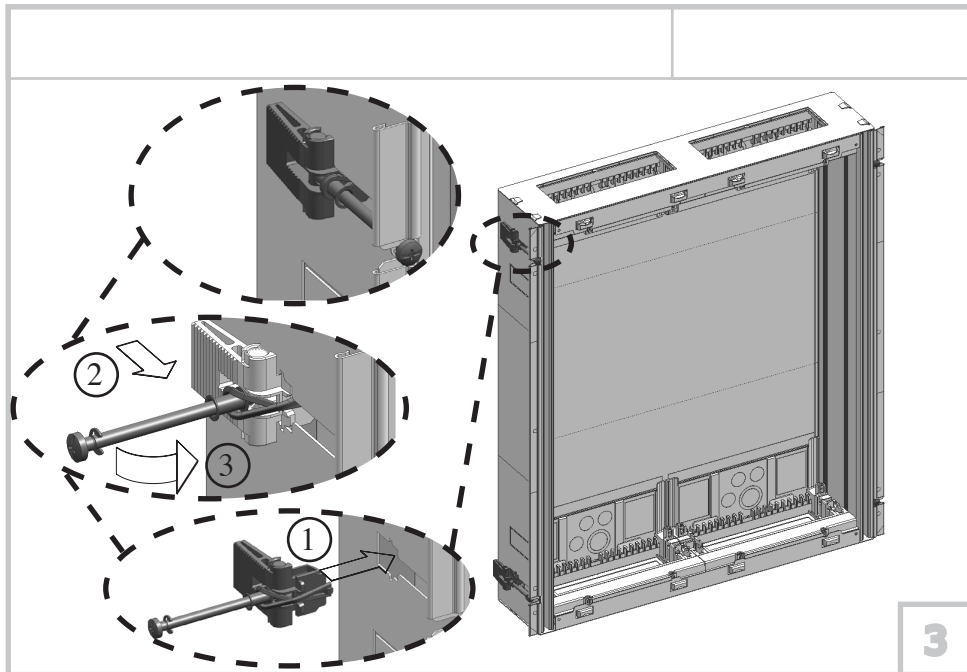

DE

Arbeiten an elektrischen Betriebsmitteln/
Anlagen dürfen nur durch eine ausgebildete
Elektrofachkraft gemäß DIN 57105 Teil 1
/ VDE 0105 Teil 1 / DIN EN 50110-1 durchge-
führt werden.

FR

Seul le personnel qualifié en électricité selon
DIN 57105 part 1 / VDE 0105 part 1 / DIN
EN 50110-1 est autorisé à travailler sur instal-
lation électrique.

GB

Only qualified electrical personell according
to DIN 57105 part 1 / VDE 0105 part 1 / DIN
EN 50110-1 are allowed to work on electrical
installations.

ES

Sólo electricistas cualificados según norma
DIN 57105 part 1 / VDE 0105 part 1 / DIN
EN 50110-1 están autorizados a trabajar en
instalaciones.

SE

Endast behörig personal enligt DIN 57105 part
1 / VDE 0105
part 1 / DIN EN 50110-1 är tillåten att arbeta
med elektriska installationer.

RU

Согласно DIN 57105, часть 1 /
VDE0105, часть 1 / DIN EN 50110-1, на
электрических установках разрешается
работать только квалифицированному
персоналу.

IT

Solo a personale qualificato, secondo DIN
57105 part 1 / VDE 0105 part 1 / DIN EN
50110-1 é consentito di lavorare su installazi-
oni elettriche.